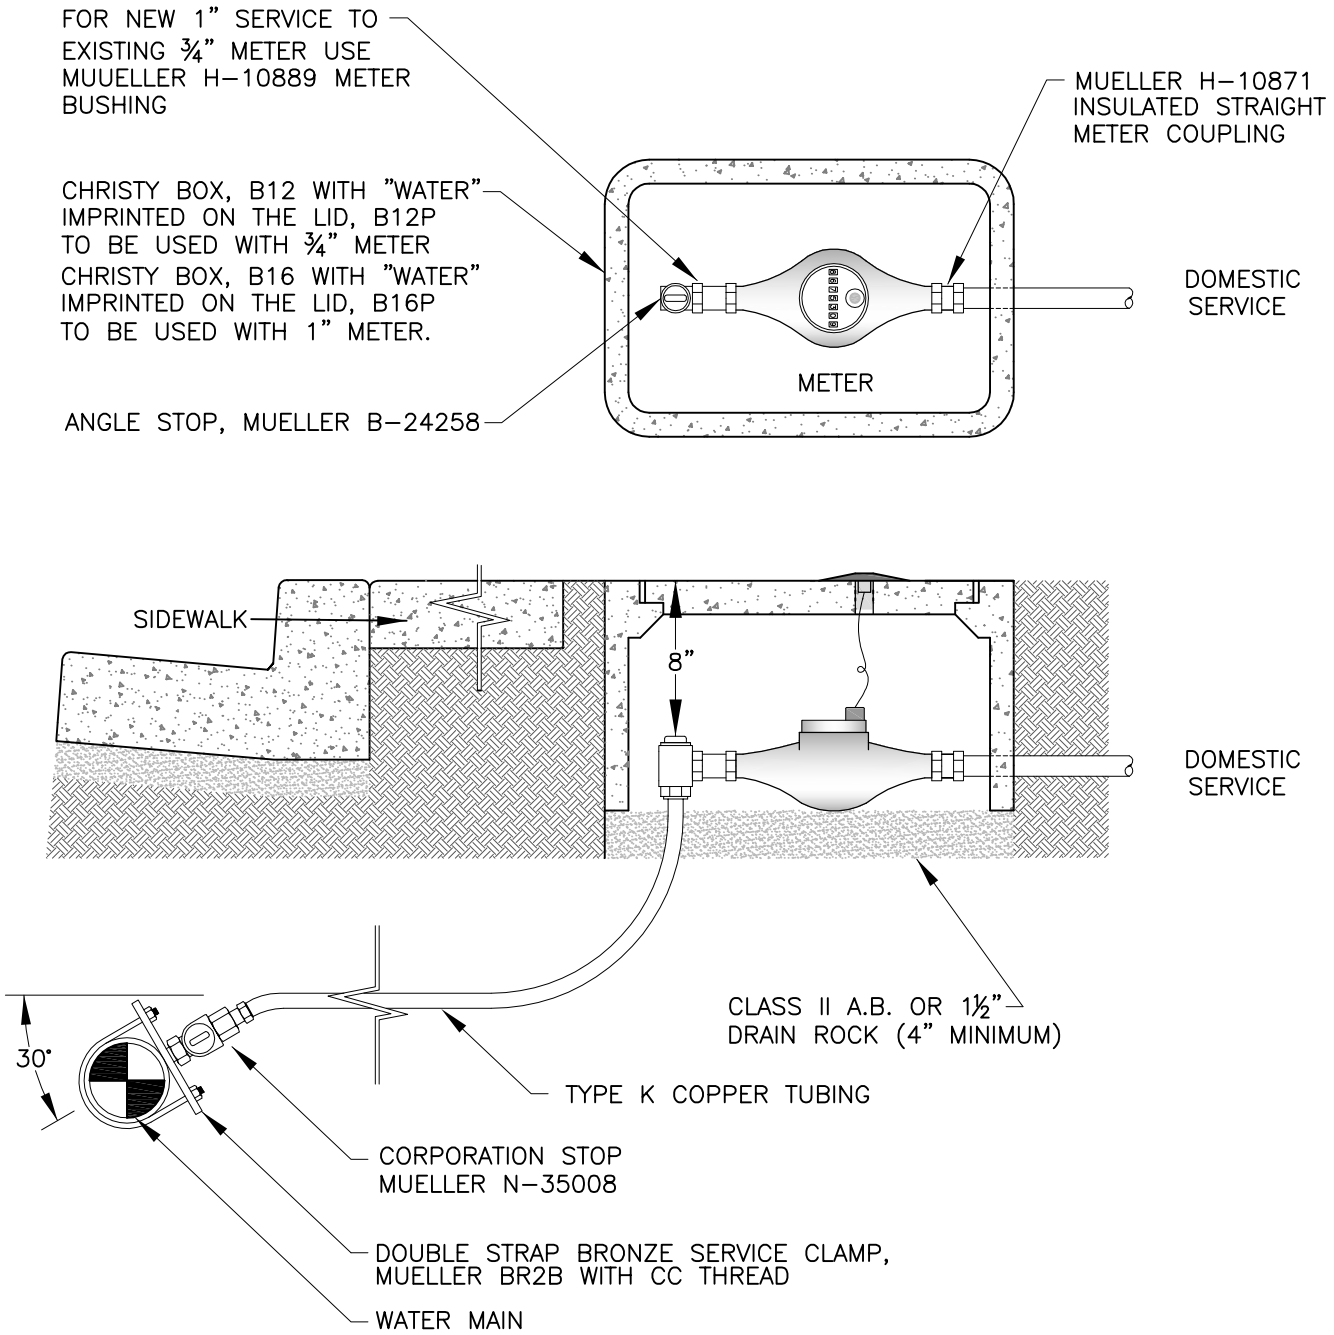

NOTES

1. ALL CORP STOPS, ANGLE METER STOPS, COUPLINGS AND CONNECTIONS SHALL BE LEAD FREE MUELLER 110 COMPRESSION TYPE FITTINGS OR APPROVED EQUIVALENT BY CITY.
2. METER INSTALLATION MAY REQUIRE CITY ISSUED, ELECTRONIC RADIO READ UNIT, AT CITY'S DIRECTION.

City of San Bruno Standard Detail	¾"or 1" RESIDENTIAL WATER SERVICE	DATE: AUG 2011 DRAWN BY: JMH
	CITY ENGINEER: APPROVED BY: WING WONG R.C.E. C35688	W-01 DETAIL NO: