


SETBACK DISTANCE _____

CONCRETE BOX WITH LID LABELED 'SEWER'. TO BE SET A MINIMUM OF 3" ABOVE POP-UP CAP. CAST IRON LIDS ARE REQUIRED IN DRIVEWAYS OR AREAS ACCESSED BY VEHICLES



3 7/8" BACK FLOW RELEASE CAP

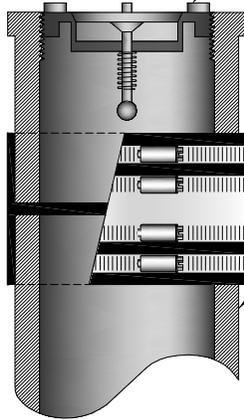

DETAIL A

CAST IRON HUB

4" ADJUSTABLE REPAIR COUPLING (ARC) WITH METAL REINFORCED CENTER BAND, TYP.

CAST IRON PIPE



4" C.I.P. LONG, 1/8 BEND


2% MIN. SLOPE

APPROVED PIPE PER CAL. PLUMBING CODE

4" MINIMUM CLASS II AGGREGATE BASE OR 1 1/2" DRAIN ROCK

APPROVED PIPE PER CAL. PLUMBING CODE

HOME OWNER'S RESPONSIBILITY

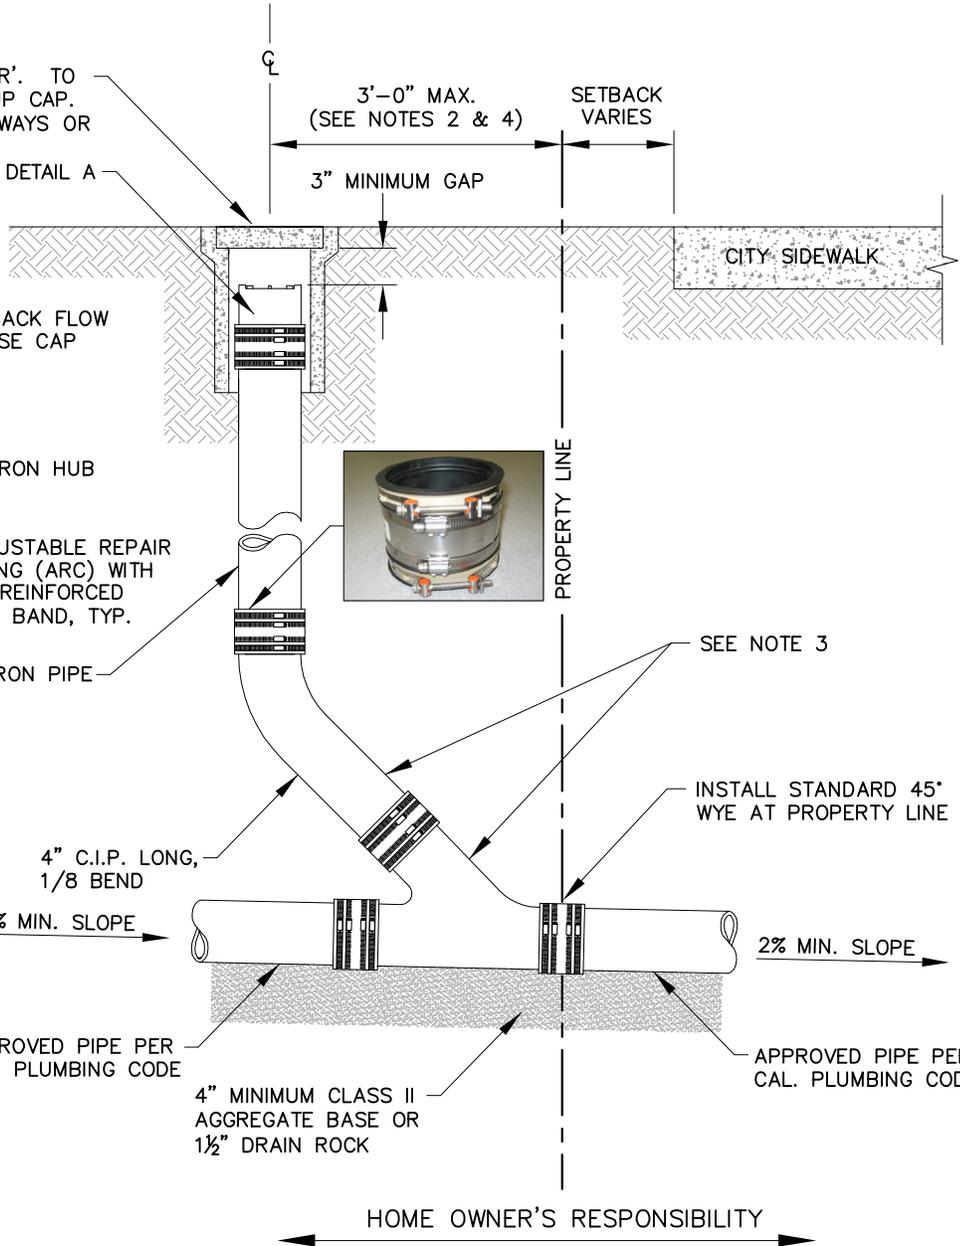

NOTES:

1. ANY EXCAVATION REQUIRES NOTIFICATION TO UNDERGROUND SERVICE ALERT (USA) 48 HOURS IN ADVANCE. CALL 811
2. MAINTENANCE SERVICE WILL BE PROVIDED BY THE CITY FOR CLEANOUTS THAT MEET DESIGN SPECIFICATIONS, ARE BEHIND THE SETBACK DISTANCE AND WITHIN 3'-0" OF THE PROPERTY LINE.
3. LONG 1/8 BEND AND WYE CONNECTION MUST BE CAST IRON PIPE (C.I.P.). CLAY AND PLASTIC PIPE ARE NOT ACCEPTABLE.
4. ANY DEVIATION FROM CLEANOUT LOCATION REQUIRES APPROVAL OF THE CITY ENGINEER. WORK IN THE CITY RIGHT-OF-WAY REQUIRES AN ENCROACHMENT PERMIT FROM S.B. PUBLIC SERVICES DEPARTMENT.
5. EXCAVATIONS 5'-0" OR DEEPER ARE REQUIRED TO HAVE TRENCH STABILIZATION.
6. ANY REPAIRS TO THE SEWER LATERAL ARE THE SOLE RESPONSIBILITY OF THE PROPERTY OWNER.



City of San Bruno
Standard Detail

4" SEWER CLEANOUT

CITY ENGINEER:

APPROVED BY: WING WONG

R.C.E. C35688

DATE: JAN 2016

DRAWN BY: JMH

SS-02

DETAIL NO: